


MOF DT 13.2 KV/110V CT 30/5A


22KV 21203

DM

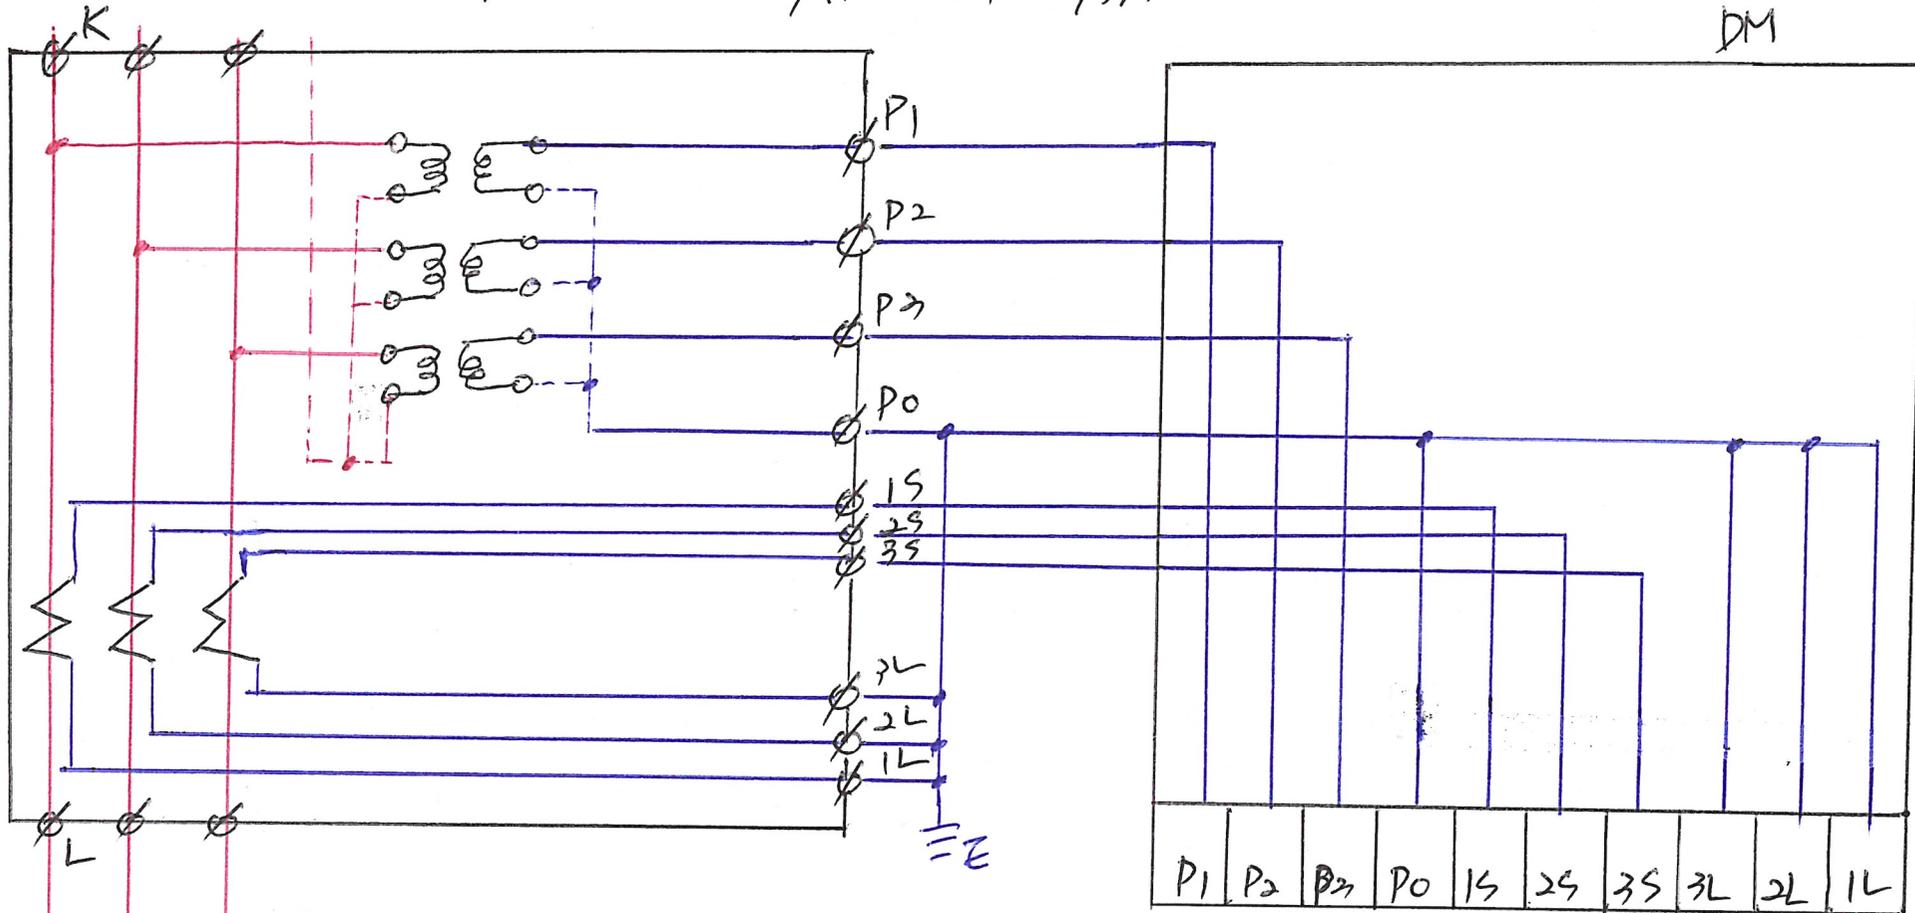

PF



PT $\frac{22900}{\sqrt{3}} / \frac{190}{\sqrt{3}}$ (13200/110V)

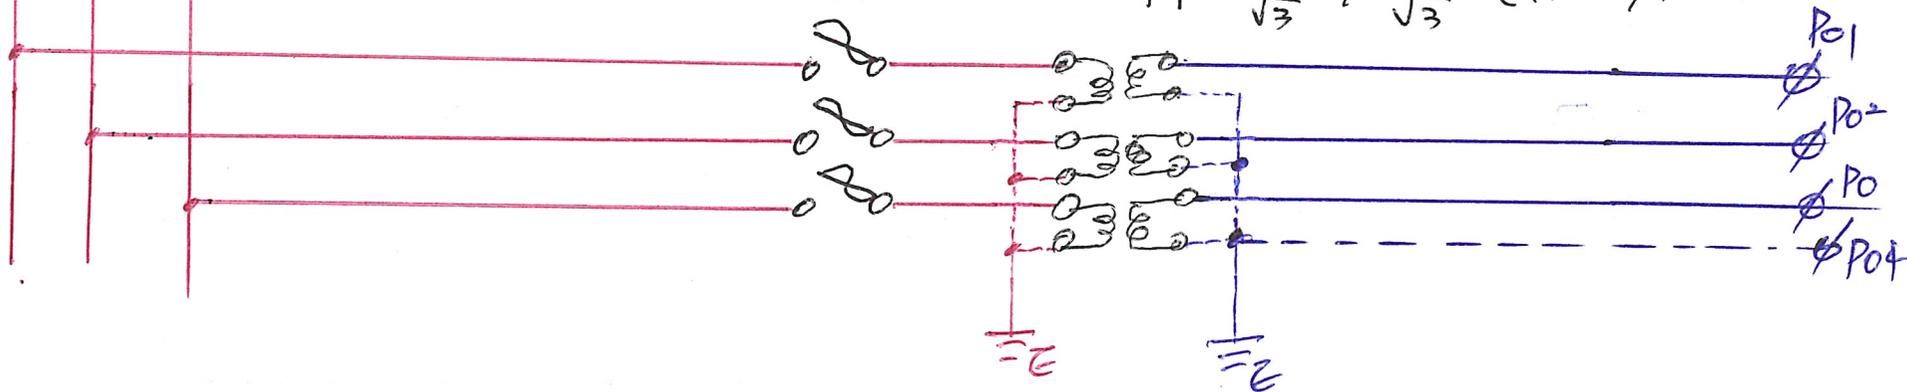


김재운

MOF PT 3.2KV/110V. CT30/5A

DM

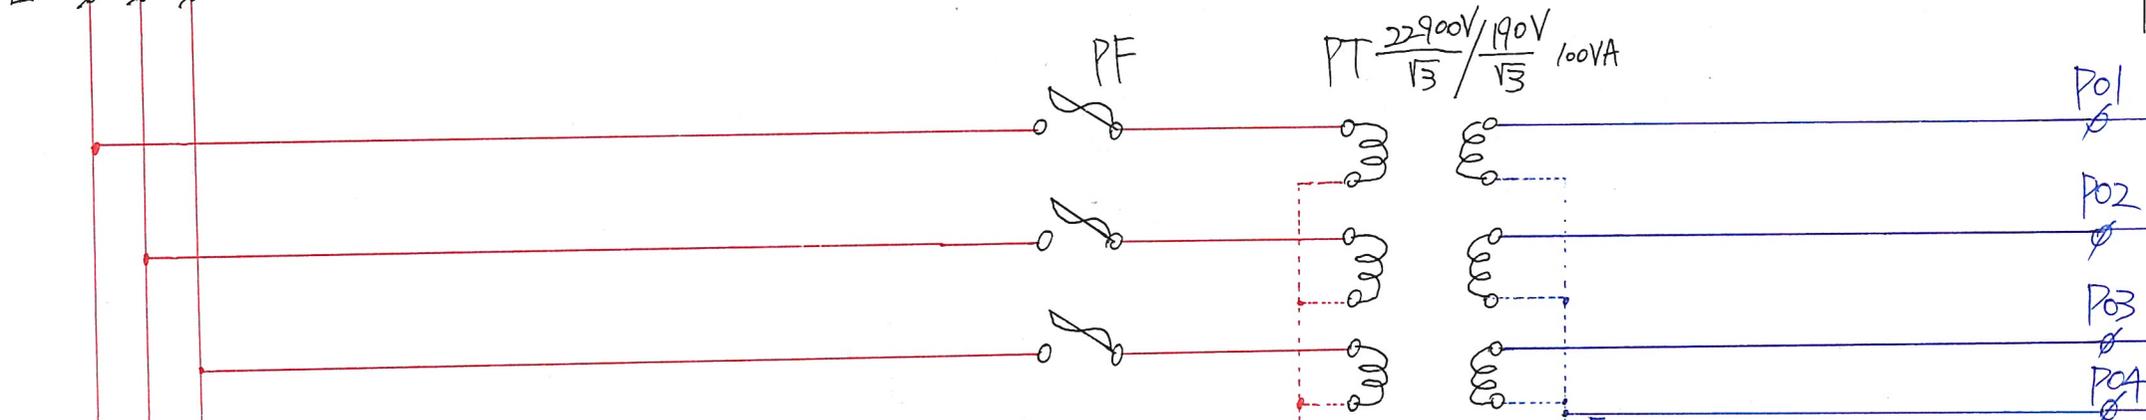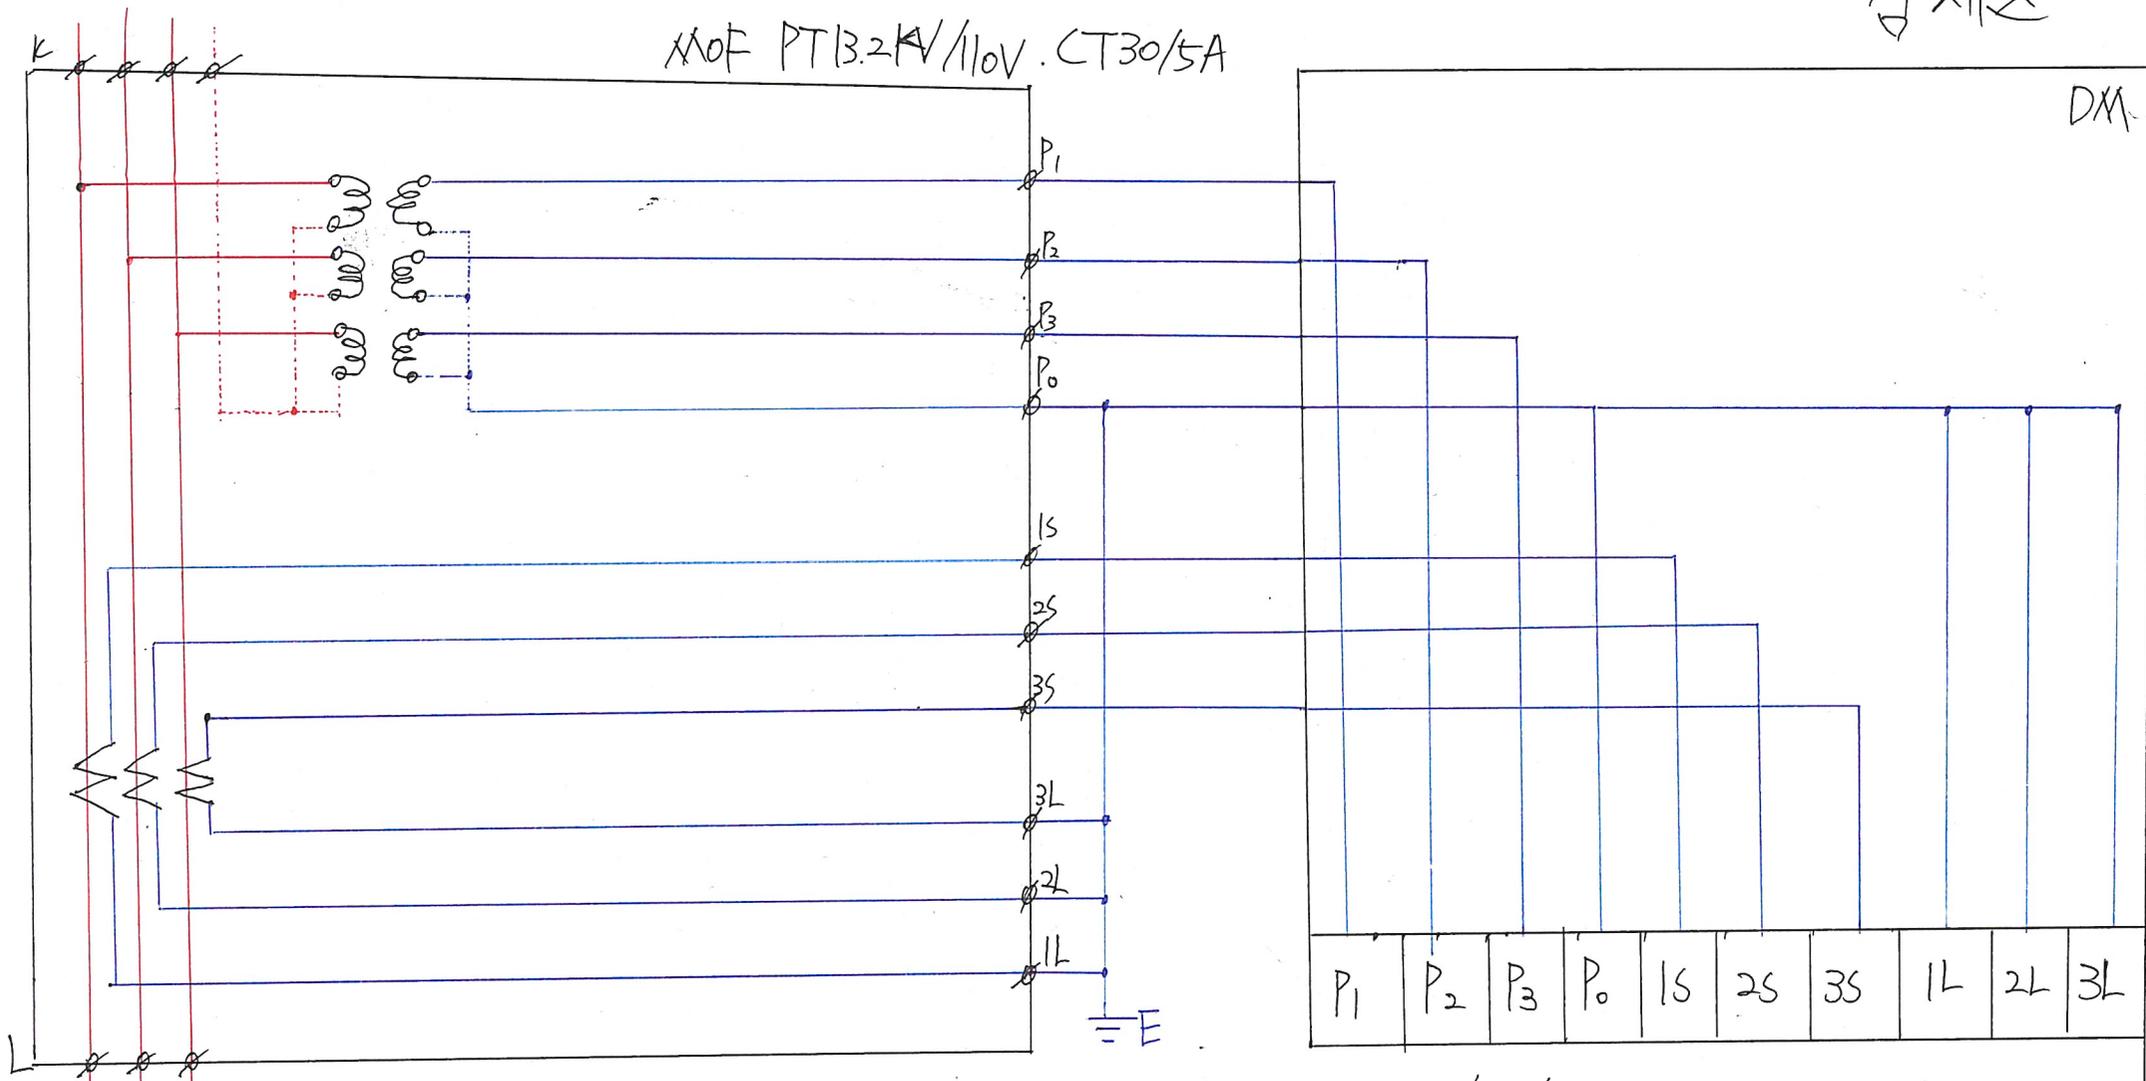

3상하 전수

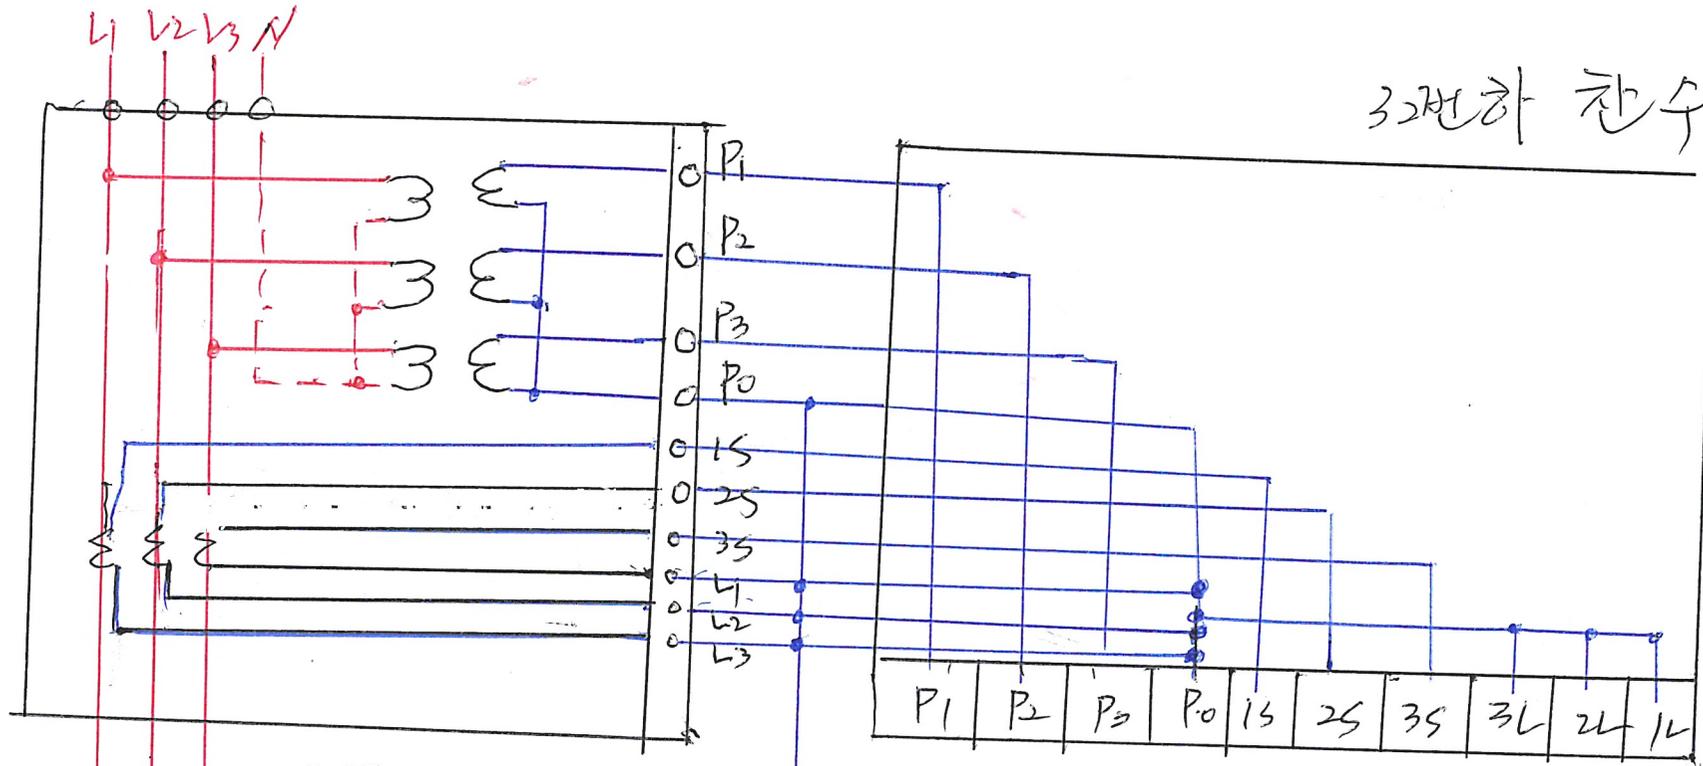

FOH
 PTB 13.2KV/110V
 CTB 30/5A

